


NOTICE OF PRODUCT CERTIFICATION

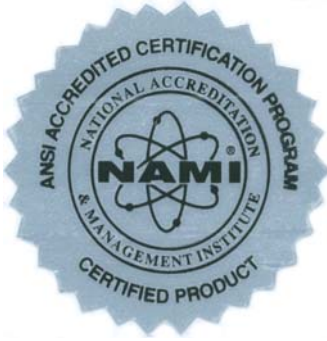

CERTIFICATION NO: NI015719
DATE: 01/16/2023
CERTIFICATION PROGRAM: Fire
COMPANY: Seves Glass
CODE: 2322-1
EXPIRATION DATE: 05/31/2026

This certification represents product conformity to the applicable specification and that certification criteria has been satisfied. A NAMI approved certification label must be applied to the product to claim certification status. To affirm the certification status, please visit www.namicertification.com. NAMI is accredited to the ISO/IEC 17065 by the ANSI National Accreditation Board (ANAB) and the Standards Council of Canada (SCC).

COMPANY NAME AND ADDRESS	PRODUCT DESCRIPTION
Seves Glass Block, Inc. 10576 Broadview Road Broadview Heights, OH 44147	Series "1919_13 F120" Fire-Rated Seves Glass Block Unit (w/ (2) 0.25" x 1.5" Strong-Tie SDS HD Connector Screw Double-Barrier Coating/16" O.C. Both Sides/ Lehigh Heidelberg Type S Masonry Cement w/Crystalline Silica/4" Truss type 9-Gauge wire reinforcement & 3M Fire Barrier Water Tight Sealant 1000 NS) Manufacturer Specific Glass Blocks for Installation in 120 Minute Locations Max Opening: 137ft ² or W-124.63" & H-163.69" Minimum Glass Block Thickness: 5.13"

SPECIFICATION	PRODUCT RATING
ASTM E119-20 UL 263-19 CAN/ULC-S101-14	120 Minutes With Hose Stream

TEST REPORT

ICC NTA, LLC Test Report No: SGB1042921-110

Administrator's Signature: _____

NATIONAL ACCREDITATION AND MANAGEMENT INSTITUTE, INC.

4794 George Washington Memorial Highway

Hayes, VA 23072

Tel: (804) 684-5124

nami@namiinc.com